A CURA DELL'INSTALLATORE
A CARE BY THE INSTALLER
AUX SOINS DE L'INSTALLATEUR
Eine Betreuung durch den INSTALLATEUR
A CUIDADO POR EL INSTALADOR
Um cuidado pelo instalador
Een zorg door de INSTALLATEUR

RKE 03-30
RKH 19-30
RKS 3V 10-40

LINEA ALIMENTAZIONE :
PREDISPORRE A MONTE
UNA ADEGUATA PROTEZIONE
CON INTERRUTTORE
MAGNETOTERMICO
DIFFERENZIALE

POWER LINE:
PROVIDE A PROPER PROTECTION
WITH DIFFERENTIAL
MAGNETOTHERMAL SWITCH

LIGNE D' ALIMENTATION:
PRÉPAREZ-VOUS À MONTER
UNE PROTECTION ADEQUATE
AVEC INTERRUPTEUR THERMIQUE
DIFFERENTIEL

STROMLEITUNG:
BEREITEN SIE VOR
ANGEMESSENEN SCHUTZ
MIT SCHALTER
magnetothermischen
DIFFERENTIAL

SUMINISTRO DE LÍNEA:
PREPARARSE PARA MONTAR
UN INTERRUPTOR DE CIRCUITO
DE PROTECCIÓN ADECUADA

POWER LINE:
FORNECER:
uma protecção adequada
com diferencial opção
magnetothermal

POWER LINE:
BIEDEN:
EEN GOEDE BESCHERMING
WITH DIFFERENTIEEL
MAGNETOTHERMAL SCHAKELAAR

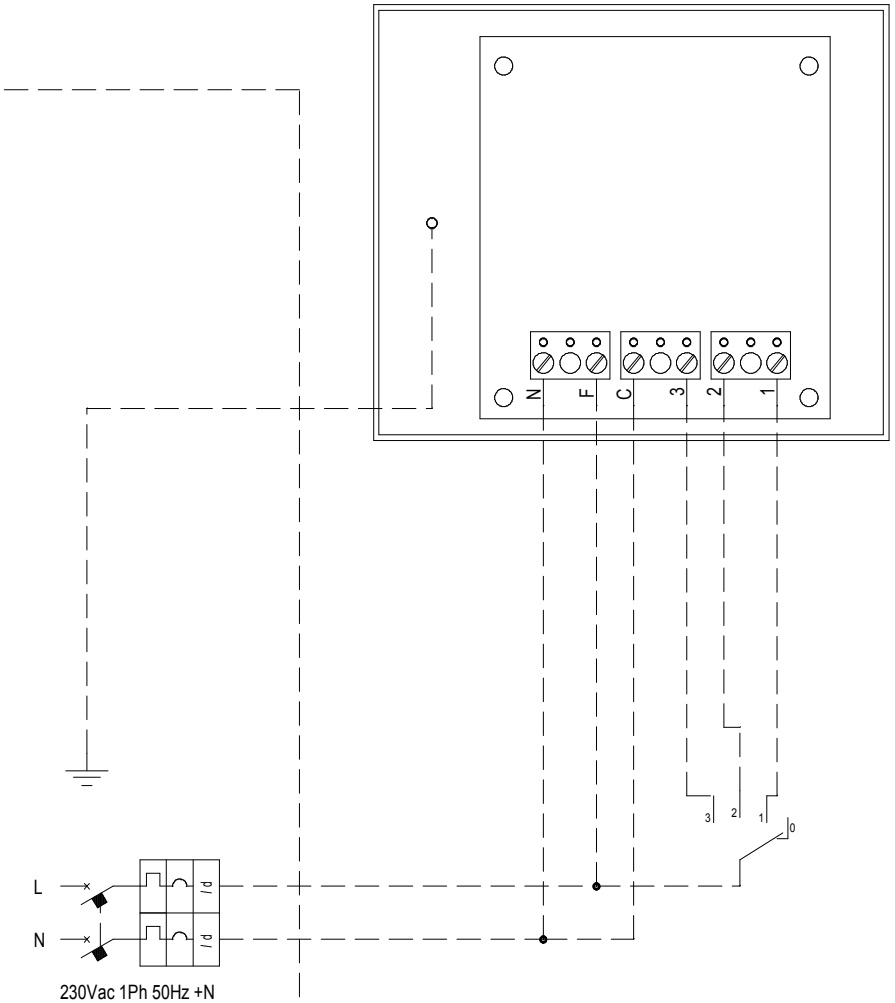

COPYING OF THIS DOCUMENT, AND GIVING IT TO OTHERS AND THE USE OR COMMUNICATION OF THE CONTENTS THEREOF, ARE FORBIDDEN WITHOUT EXPRESS AUTHORITY. OFFENDERS ARE LIABLE TO THE PAYMENT OF DAMAGES. ALL RIGHTS ARE RESERVED IN THE EVENT OF THE GRANT OF A PATENT OF THE REGISTRATION OF A UTILITY MODEL OR DESIGN

PROJECT:
FILE NAME *SELETTORE-CVU_00.sch*
TYPE:

REVISIONS		DATE	01/04/2014			UNIT 1ph	=
LAST REVISION DATE		COMMISS.	OM				+
SHEET STATUS	5	CHECK.					SHEET 2
SABIK VERSION	Ver. 16.00	APPROV.		SUBST.:	SUB. FOR:	ORIGIN:	3 N.S.

A CURA DELL'INSTALLATORE
A CARE BY THE INSTALLER
AUX SOINS DE L'INSTALLATEUR
Eine Betreuung durch den INSTALLATEUR
A CUIDADO POR EL INSTALADOR
Um cuidado pelo instalador
Een zorg door de INSTALLATEUR

RKE 40-60
RKH 40-60

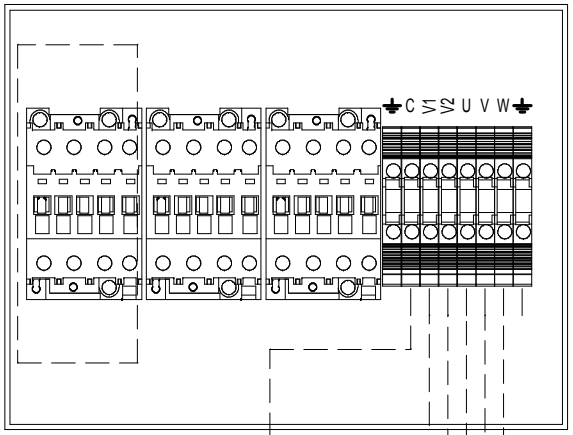

LINEA ALIMENTAZIONE :
PREDISPORRE A MONTE
UNA ADEGUATA PROTEZIONE
CON INTERRUTTORE
MAGNETOTERMICO
DIFFERENZIALE

POWER LINE:
PROVIDE A PROPER PROTECTION
WITH DIFFERENTIAL
MAGNETOTHERMAL SWITCH

LIGNE D' ALIMENTATION:
PRÉPAREZ-VOUS À MONTER
UNE PROTECTION ADEQUATE
AVEC INTERRUPTEUR THERMIQUE
DIFFERENTIEL

STROMLEITUNG:
BEREITEN SIE VOR
ANGEMESSENEN SCHUTZ
MIT SCHALTER
magnetothermischen
DIFFERENTIAL

SUMINISTRO DE LÍNEA:
PREPARARSE PARA MONTAR
UN INTERRUPTOR DE CIRCUITO
DE PROTECCIÓN ADECUADA

POWER LINE:
FORNECER:
uma protecção adequada
com diferencial opção
magnetothermal

POWER LINE:
BIEDEN:
EEN GOEDE BESCHERMING
WITH DIFFERENTIEEL
MAGNETOTHERMAL SCHAKELAAR

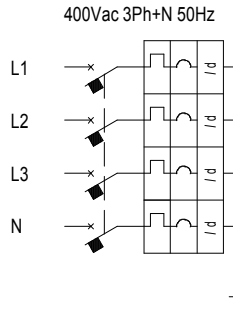



COPYING OF THIS DOCUMENT, AND GIVING IT TO OTHERS AND THE USE OR COMMUNICATION OF THE CONTENTS THEREOF, ARE FORBIDDEN WITHOUT EXPRESS AUTHORITY. OFFENDERS ARE LIABLE TO THE PAYMENT OF DAMAGES. ALL RIGHTS ARE RESERVED IN THE EVENT OF THE GRANT OF A PATENT OF THE REGISTRATION OF A UTILITY MODEL OR DESIGN

PROJECT:
FILE NAME *SELETTORE-CVU_00.sch*
TYPE:

REVISIONS		DATE	01/04/2014			UNIT 3ph	=
LAST REVISION DATE		COMMISS.	OM				+
SHEET STATUS	6	CHECK.					SHEET 3
SABIK VERSION	Ver. 16.00	APPROV.		SUBST.:	SUB. FOR:	ORIGIN:	4 N.S.